NOTE: WATER METER IN ACCRDANCE WITH THE STANDARD SPECIFICATIONS FOR WATER DISTRIBUTION. ALL FITTINGS TO BE COMPRESSION JOINT TYPE AS APPROVED BY THE CITY ENGINEER.

MINIMUM TAP SPACING SHALL BE 2' O.C.

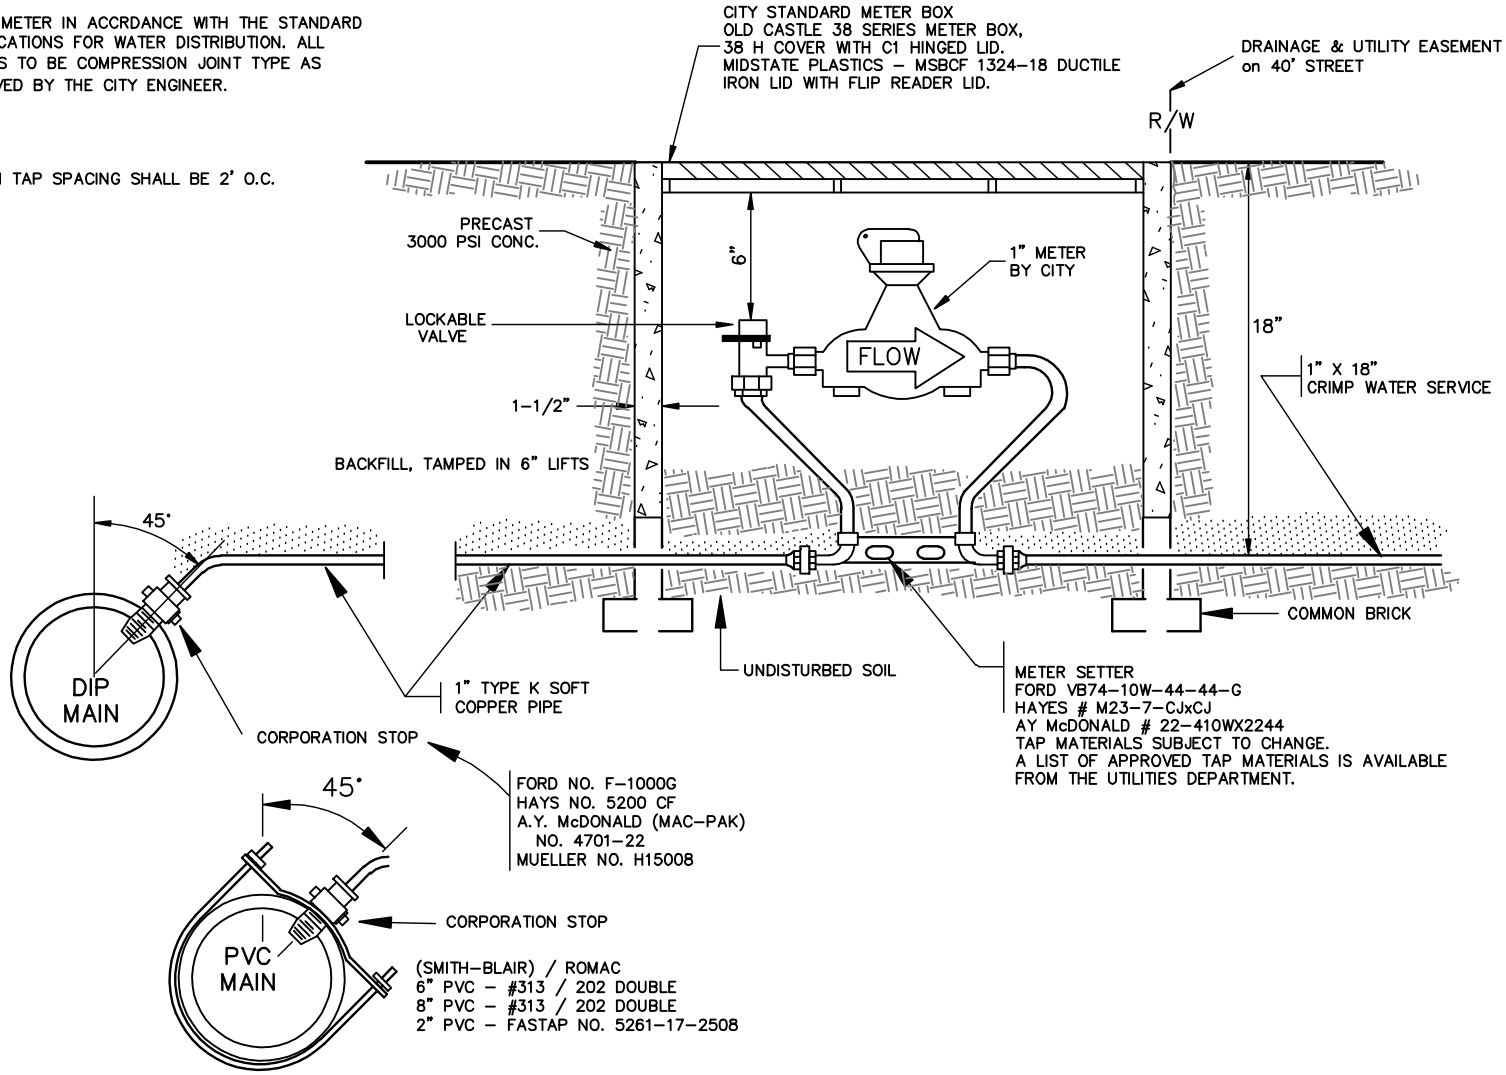

REVISED	F.B.	PG.	DATE: AUG. 14, 1984	Standard Detail	OFFICE OF THE CITY ENGINEER GASTONIA, N.C.
02–02–01 05–25–01 03–10–03 08–16–05 03–03–09			SCALE: NTS DRAWN BY: MLB, EZ, JJ CHECKED BY: DCC, FAP CITY ENGINEER: FAP	1" Water Tap and Meter Details	FILE NO. 71B-20C