


TOP ELEV.

NOTE: SEE FILE NO. 71C-18 & 19 FOR DIMENSIONS
SEE 71C-10 FOR FRONT ELEV.

NOTE: 1 (ONE) CUBIC FOOT MINIMUM OF #57 WASHED STONE IS REQUIRED BEHIND EACH WEEP HOLE.

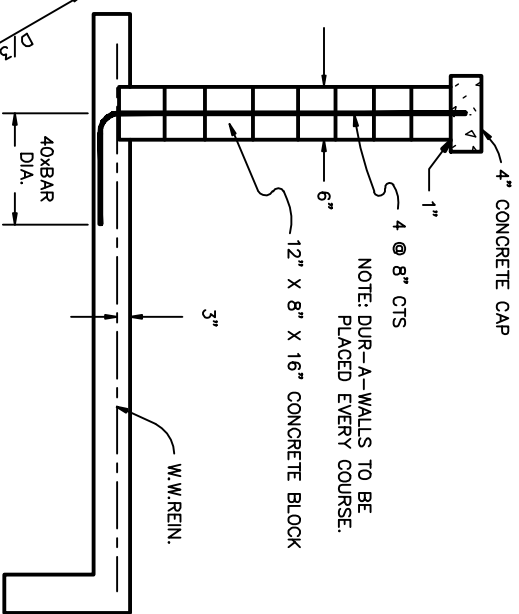

TYPICAL SECTION A-A

NOTE: FILL EVERY CAVITY COMPLETELY WITH 3000 PSI CONCRETE.

CONCRETE SHALL NOT FALL MORE THAN THE HEIGHT OF 5 LAYERS OF BLOCK.

REVISED F.B. PG. DATE: **4/22/74**

SCALE: **None**

5/21/79
9/14/90

DRAWN BY: **PNR**

CHECKED BY: **NBM, FAP**

CITY ENGINEER: **DBC**

Standard Detail

**Concrete Block Headwall
With Wing Walls**

OFFICE OF THE
CITY ENGINEER

GASTONIA, N.C.

FILE NO. **71C-11**